


Sketch the property. Include the street or road name, Lot dimensions, locations of all buildings and paved surfaces, underground utilities and easements.

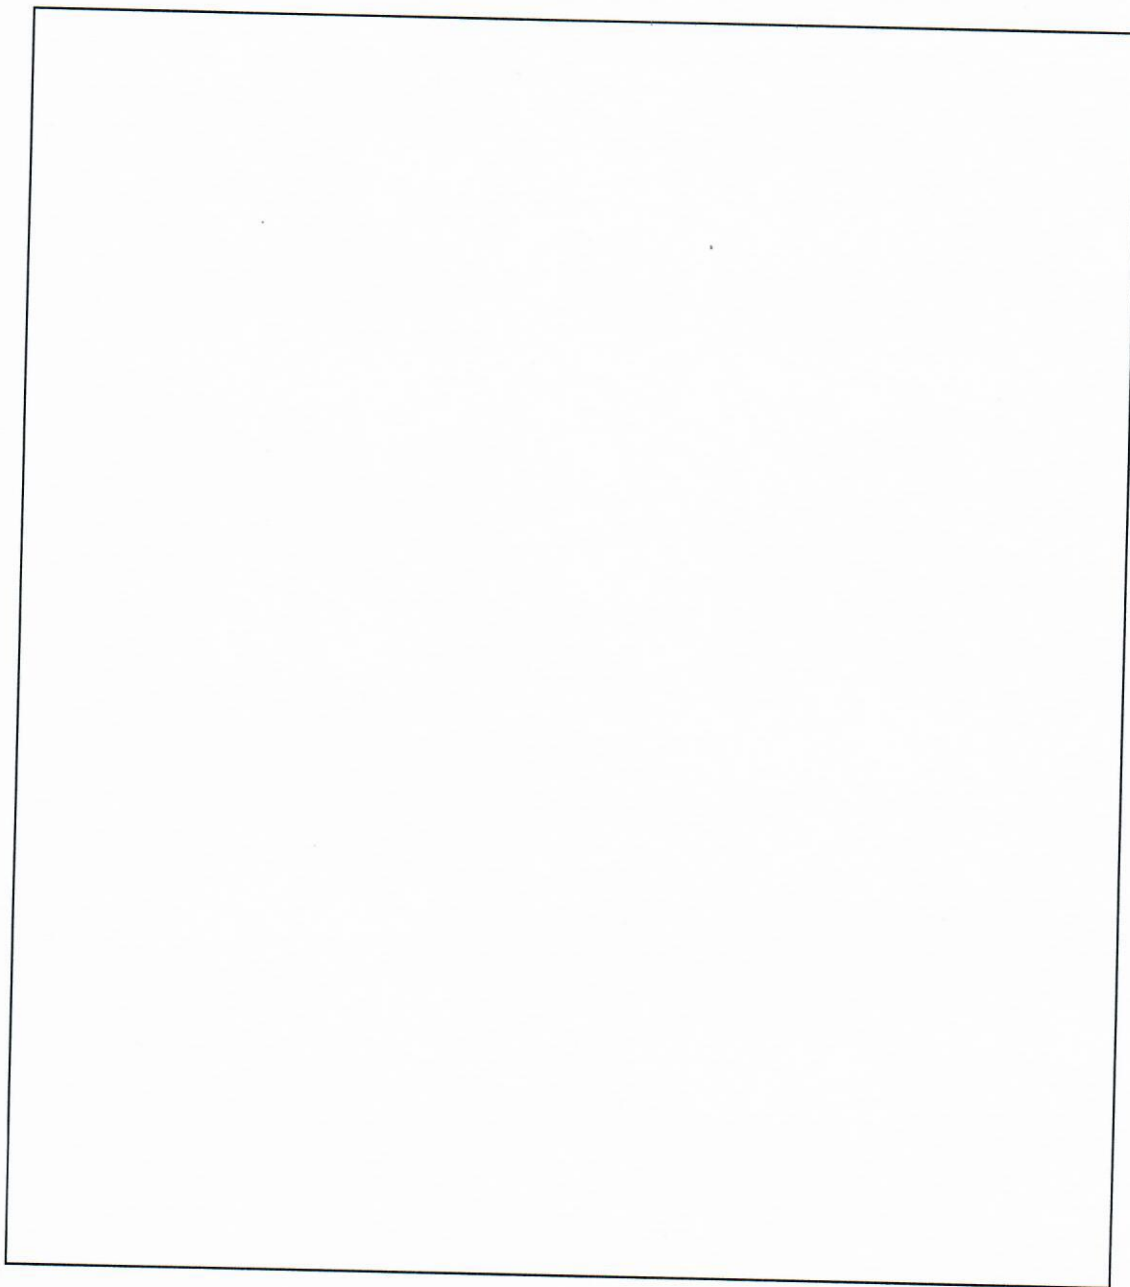

According to the Water Well Standards Act of 1985, all new wells must be located at least the following distances from the following structures:

- 10 feet from a sewer line
- 50 feet from a septic tank
- 100 feet from a septic tank absorption field
- 150 feet from a cesspool or seepage pit
- 100 feet from an animal or fowl enclosure